


FRONT LEFT SIDE

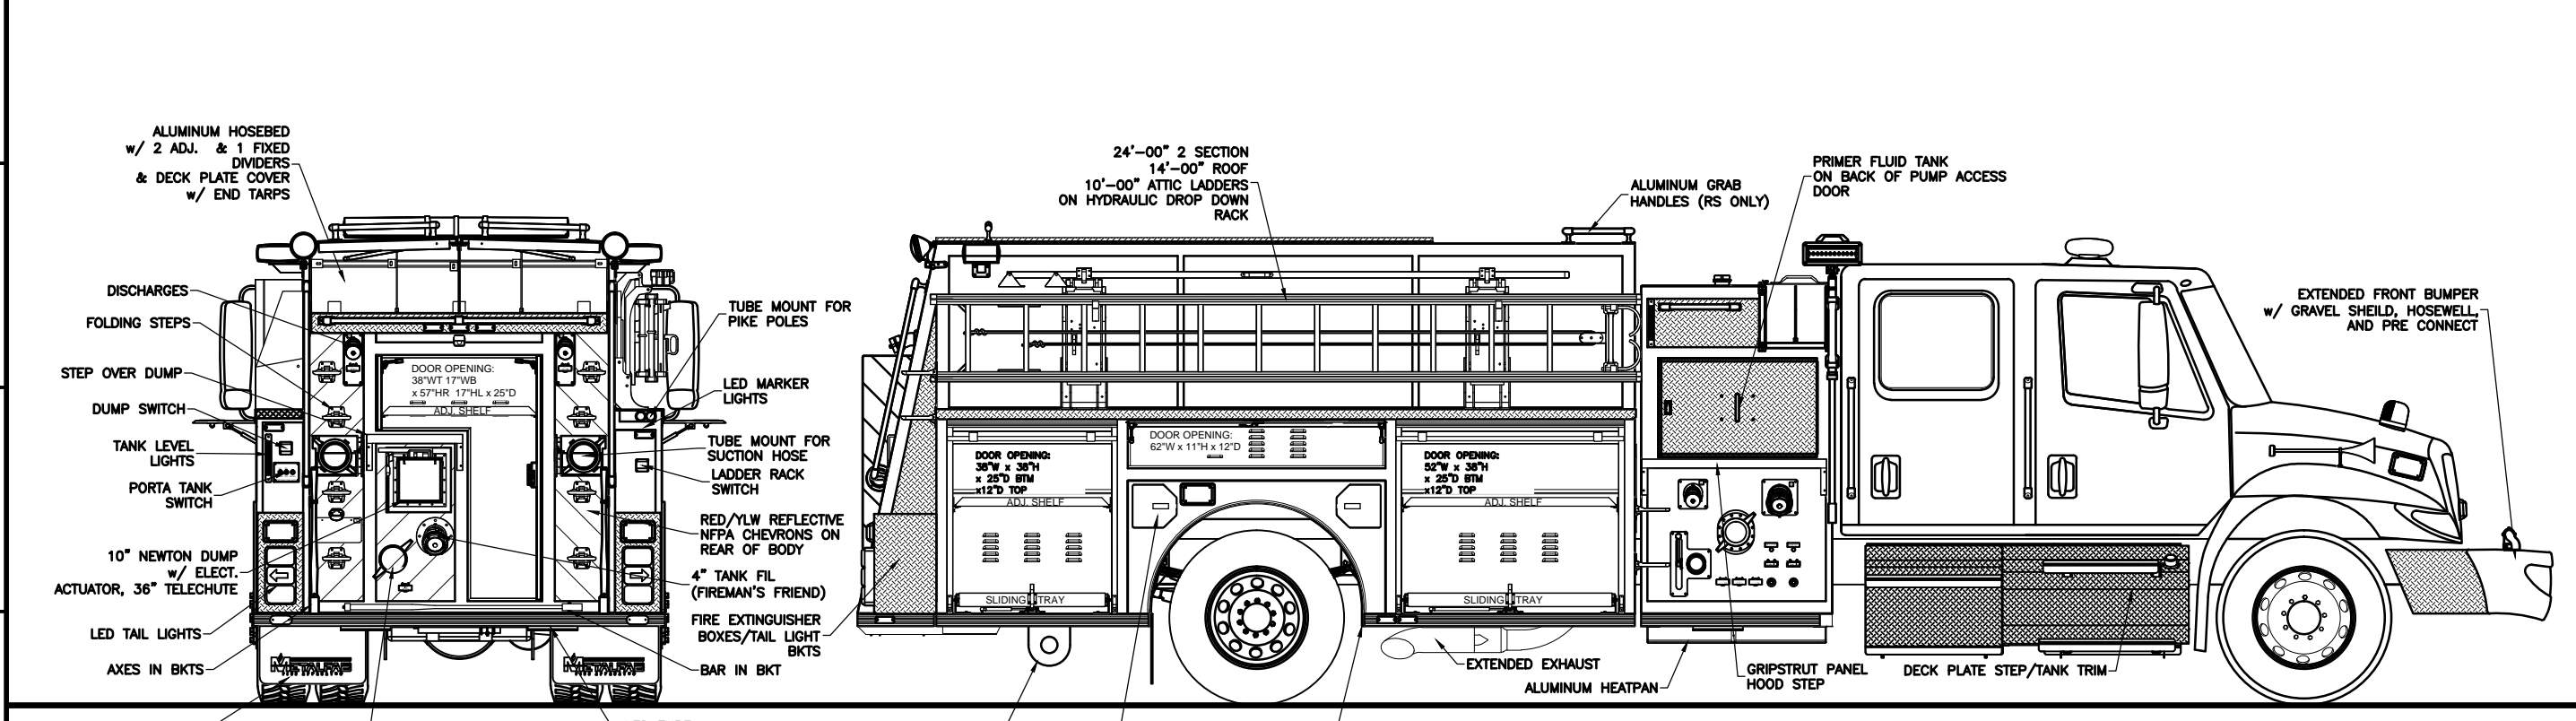

REAR RIGHT SIDE

REV	DESCRIPTION	APVD BY	DATE
1	UPDATE TO SHOP ORDER	----	05-21-14

REVISIONS

CHASSIS: INTERNATIONAL 4400 4 DOOR
 PUMP: HALE QMAX 1250 IGPM
 TANK: 1000 Imp. Gal. POLYPROPYLENE
 2 - 20 Imp. Gal. FOAM CELLS
 FOAM: HYPRO FOAMPRO 2001 DUAL TANK

SUCTION: 1 - 6" LEFT (GATED)
 1 - 6" RIGHT (GATED)
 1 - 6" REAR (5" PIPE/GATED)
 1 - 2 1/2" LEFT
 1 - 2 1/2" RIGHT
 1 - 4" TANK TO PUMP

DISCHARGES: 1 - 4" RIGHT
 1 - 3" MONITOR
 2 - 2 1/2" LEFT
 2 - 2 1/2" REAR (RS FOAM)
 1 - 2 1/2" RIGHT (FOAM)
 1 - 1 1/2" FRONT (FOAM)
 2 - 1 1/2" CROSSLAY (FOAM)
 1 - 3" TANK FILL

BELLEISLE
 FIRE DEPARTMENT
 JOB No. PROPOSAL
 DRAWN BY T CULLINS
 DATE 02-19-14
 METALFAB LTD.
 847 CENTRAL ST. CENTREVILLE
 NB. CANADA E7K 2E8

TITLE GENERAL ARRANGEMENT

DRAWING NO. FT-10595 REV 1

-ALL ALUMINUM CONSTRUCTION - ALL DIMENSIONS ARE IN INCHES & APPROXIMATE MAX. HEIGHT=120" / MAX. LENGTH=420"