
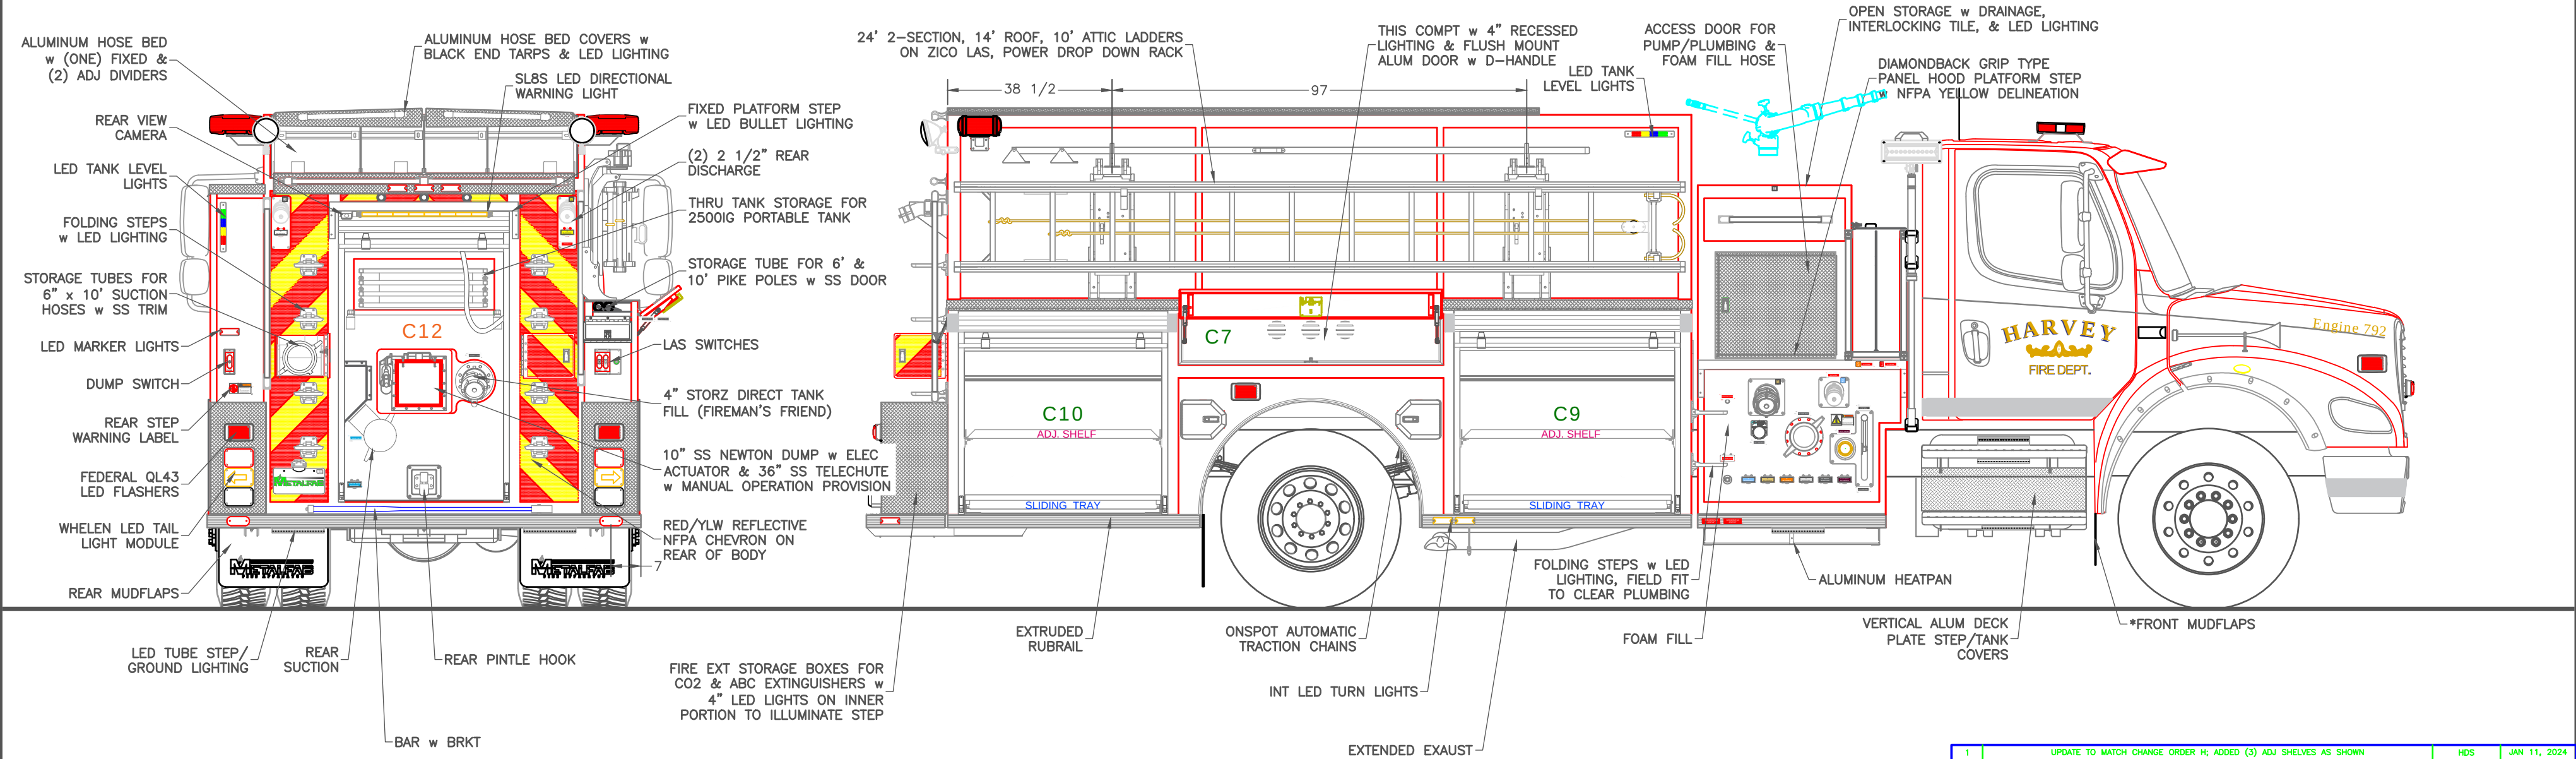


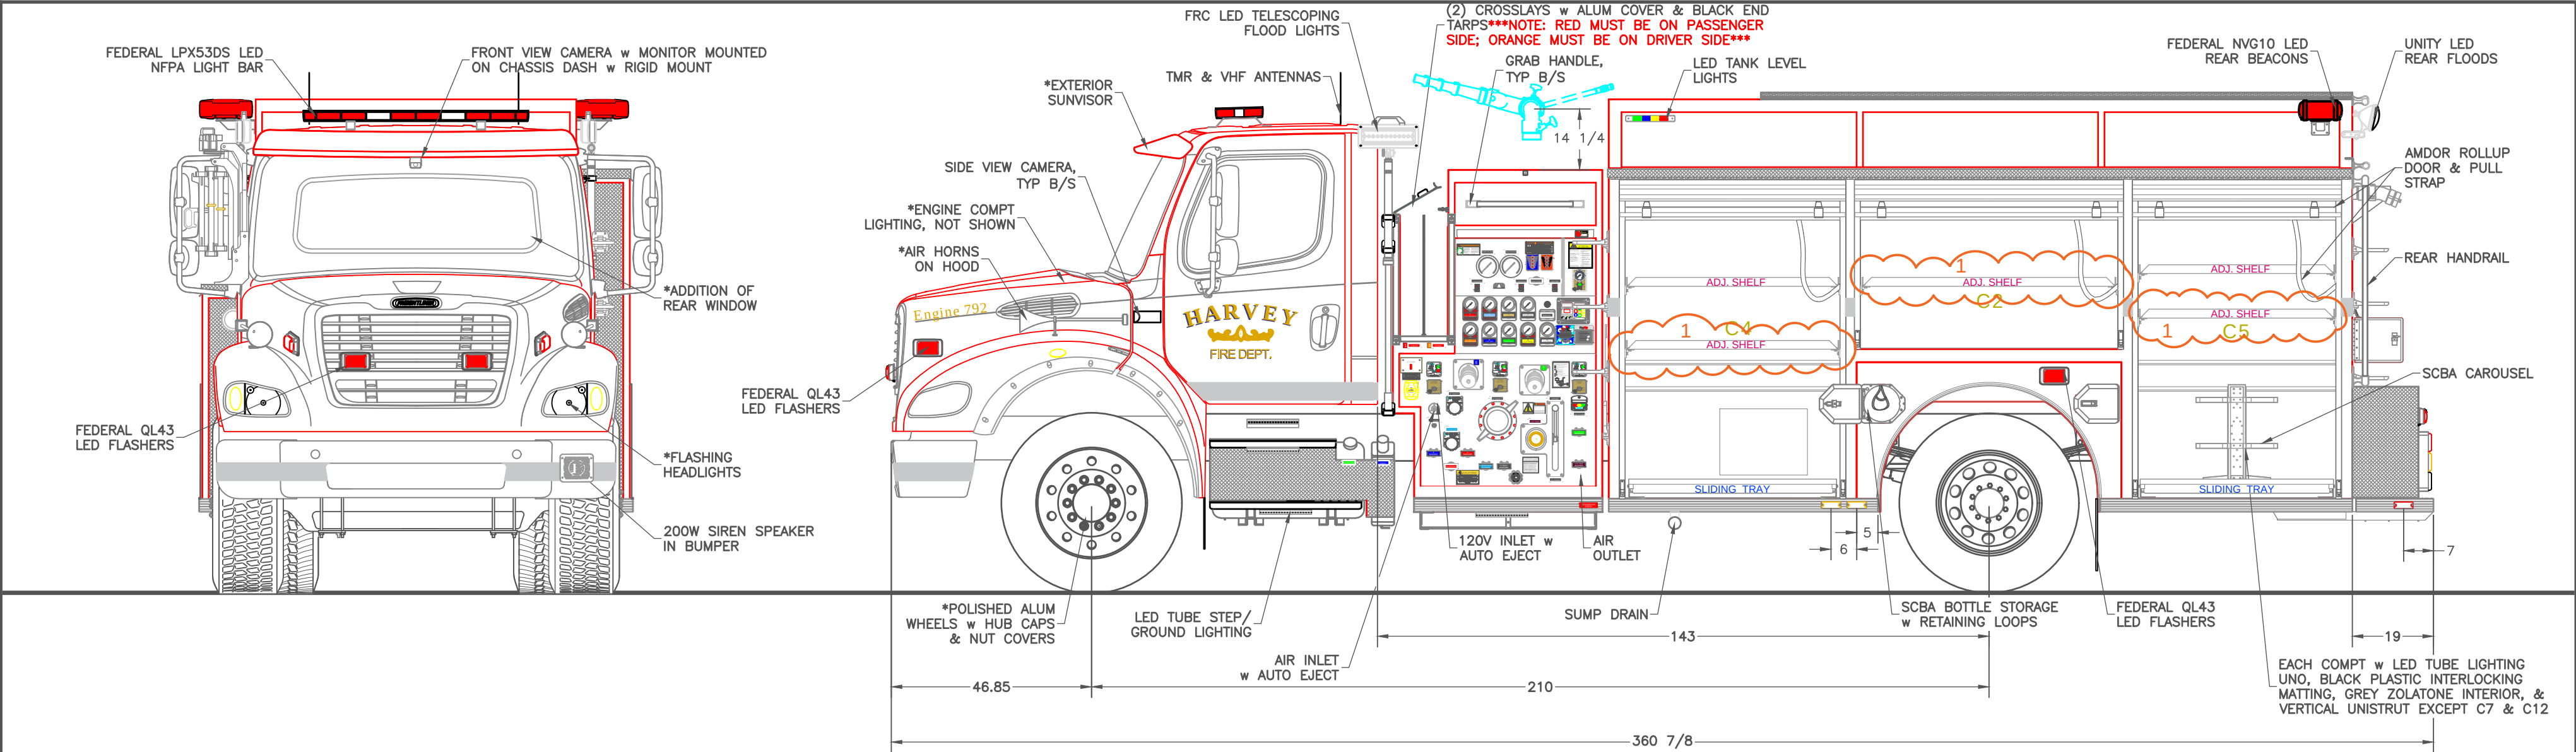

CHASSIS: FREIGHTLINER M2 112 2 DOOR
PUMP: HALE QMAX 1250 IGPM SINGLE STAGE
TANK: 1000 Imp. Gal. POLYPROPYLENE
1 - 30 Imp. Gal. FOAM CELL
FOAM: FOAM PRO 2001

SUCTION: 1 - 6" LEFT (ELEC GATE)
1 - 6" RIGHT (ELEC GATE)
1 - 6" REAR (ELEC GATE, 5" PIPE)
1 - 4" TANK TO PUMP (ELEC)
1 - 2 1/2" LEFT
1 - 2 1/2" RIGHT

DISCHARGES: 1 - 4" RIGHT (3" PIPING)
1 - 3" MONITOR
2 - 2 1/2" LEFT
2 - 2 1/2" REAR (R/S FOAM)
1 - 2 1/2" RIGHT (FOAM)
1 - 2 1/2" TANK FILL
2 - 1 1/2" CROSSLAYS (FOAM)

1	UPDATE TO MATCH CHANGE ORDER H; ADDED (3) ADJ SHELVES AS SHOWN	HDS	JAN 11, 2024
0	FIRST ISSUE		
REV	DESCRIPTION	BY	DATE
REVISIONS			
HARVEY FIRE DEPARTMENT		TITLE ACCESSORIES MOUNTING	
JOB No. 22510			
DRAWN BY HDS			
DATE AUGUST 31, 2023			
METALFAB LTD. 847 CENTRAL ST. CENTREVILLE NB. CANADA E7K 2E8		DRAWING NO. 22510-19 PG 1 OF 3	
		REV 1	