
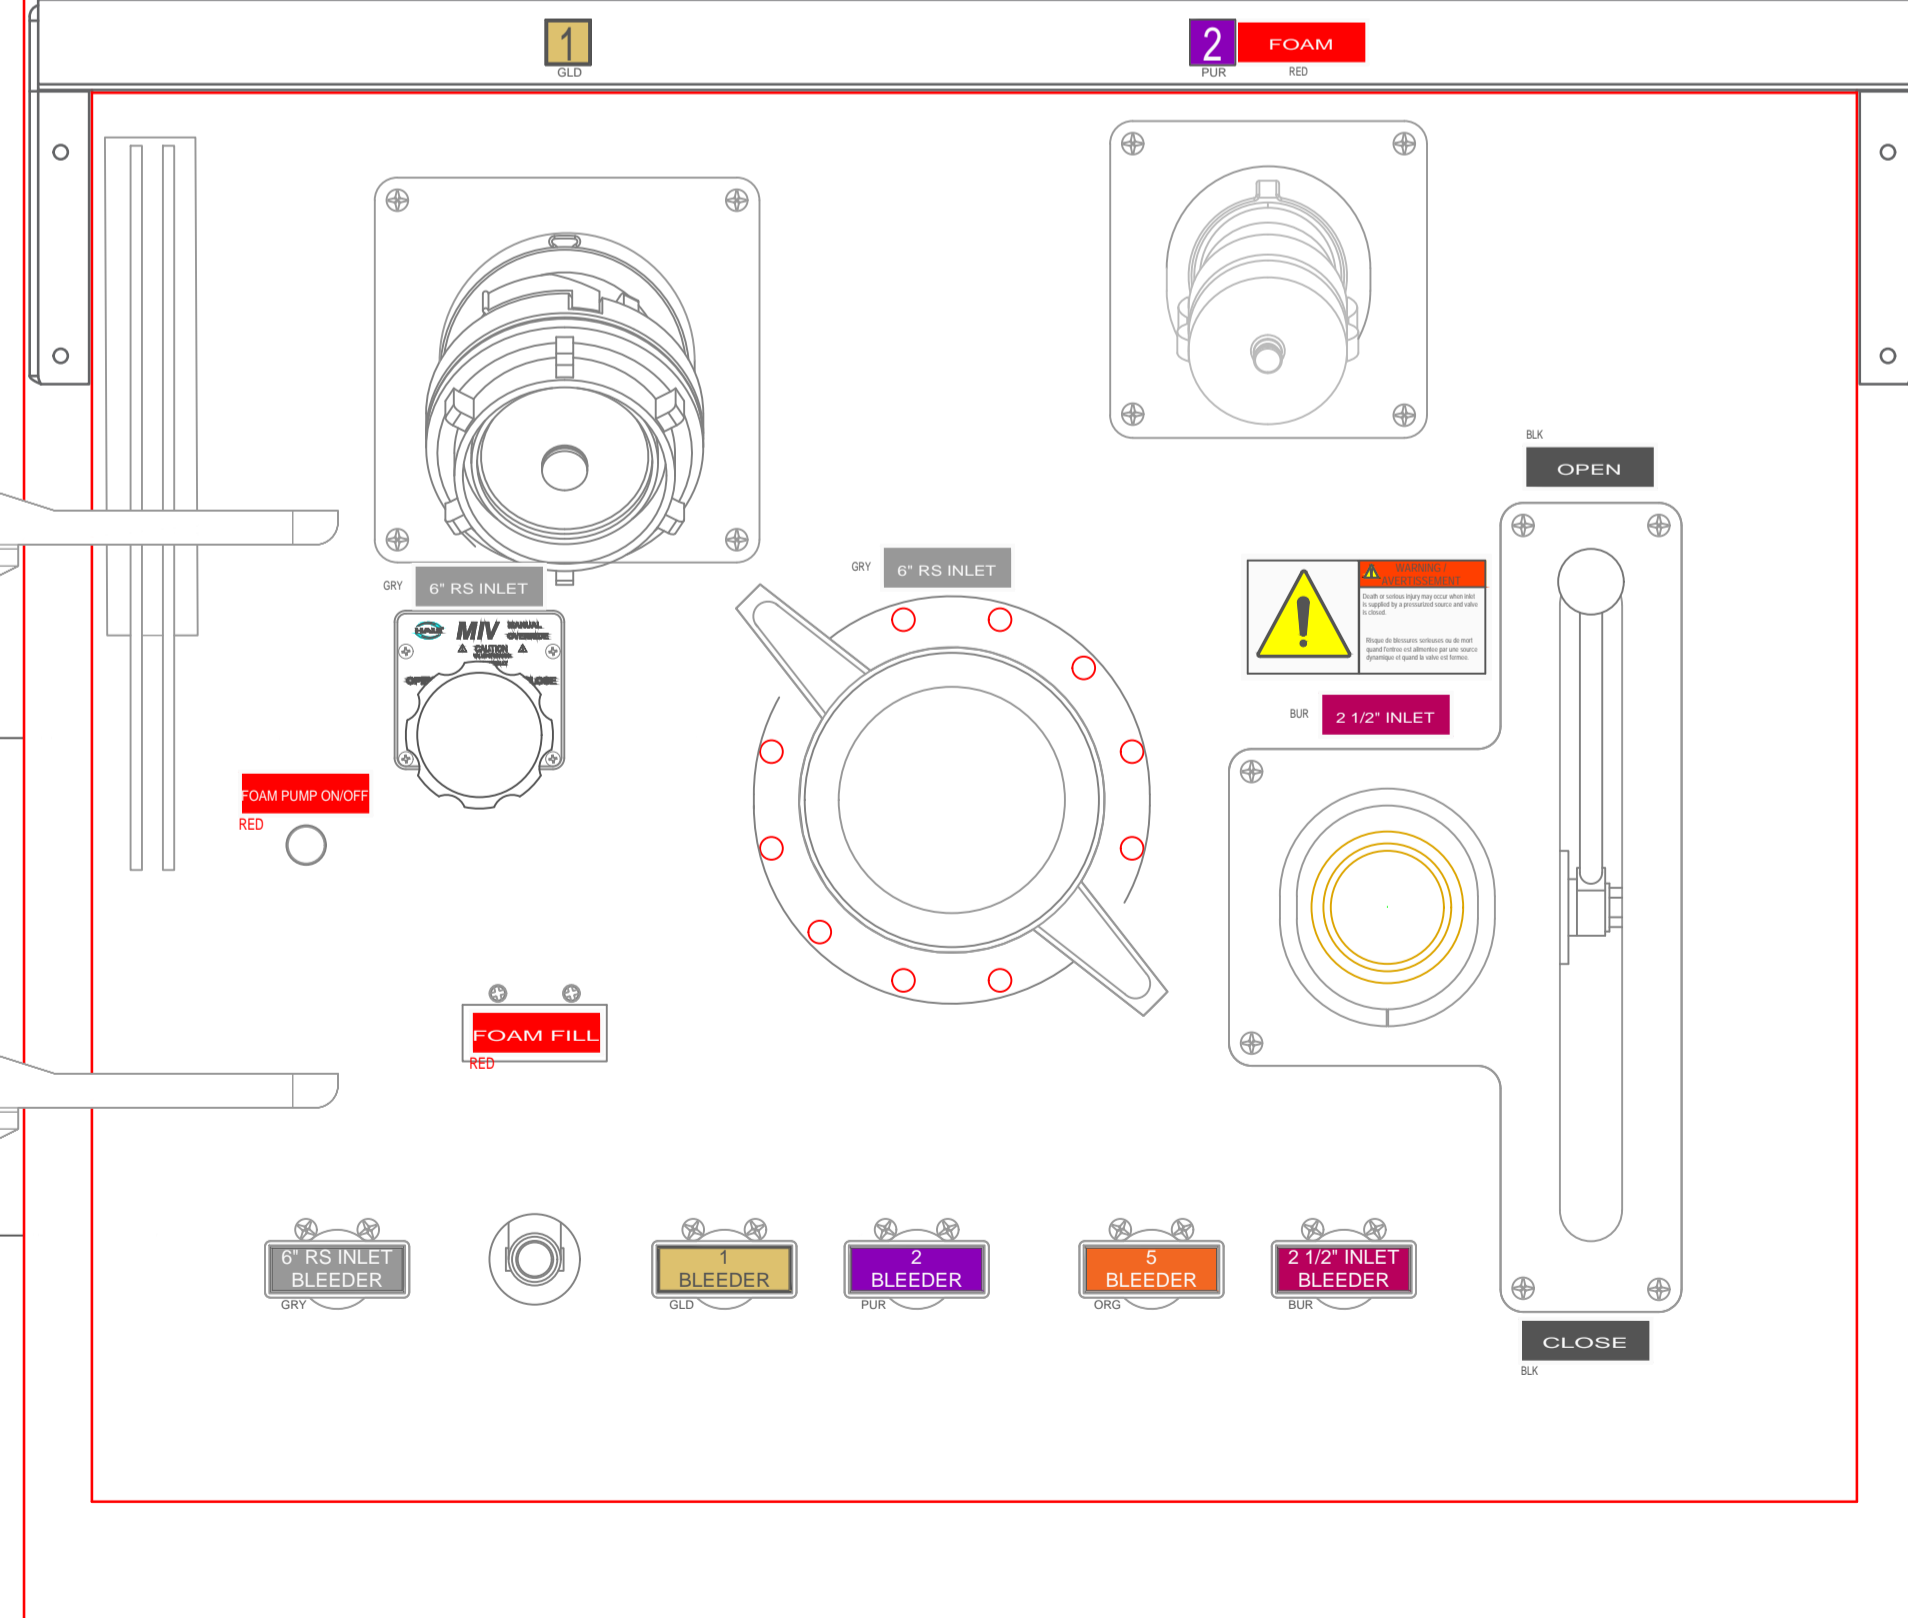
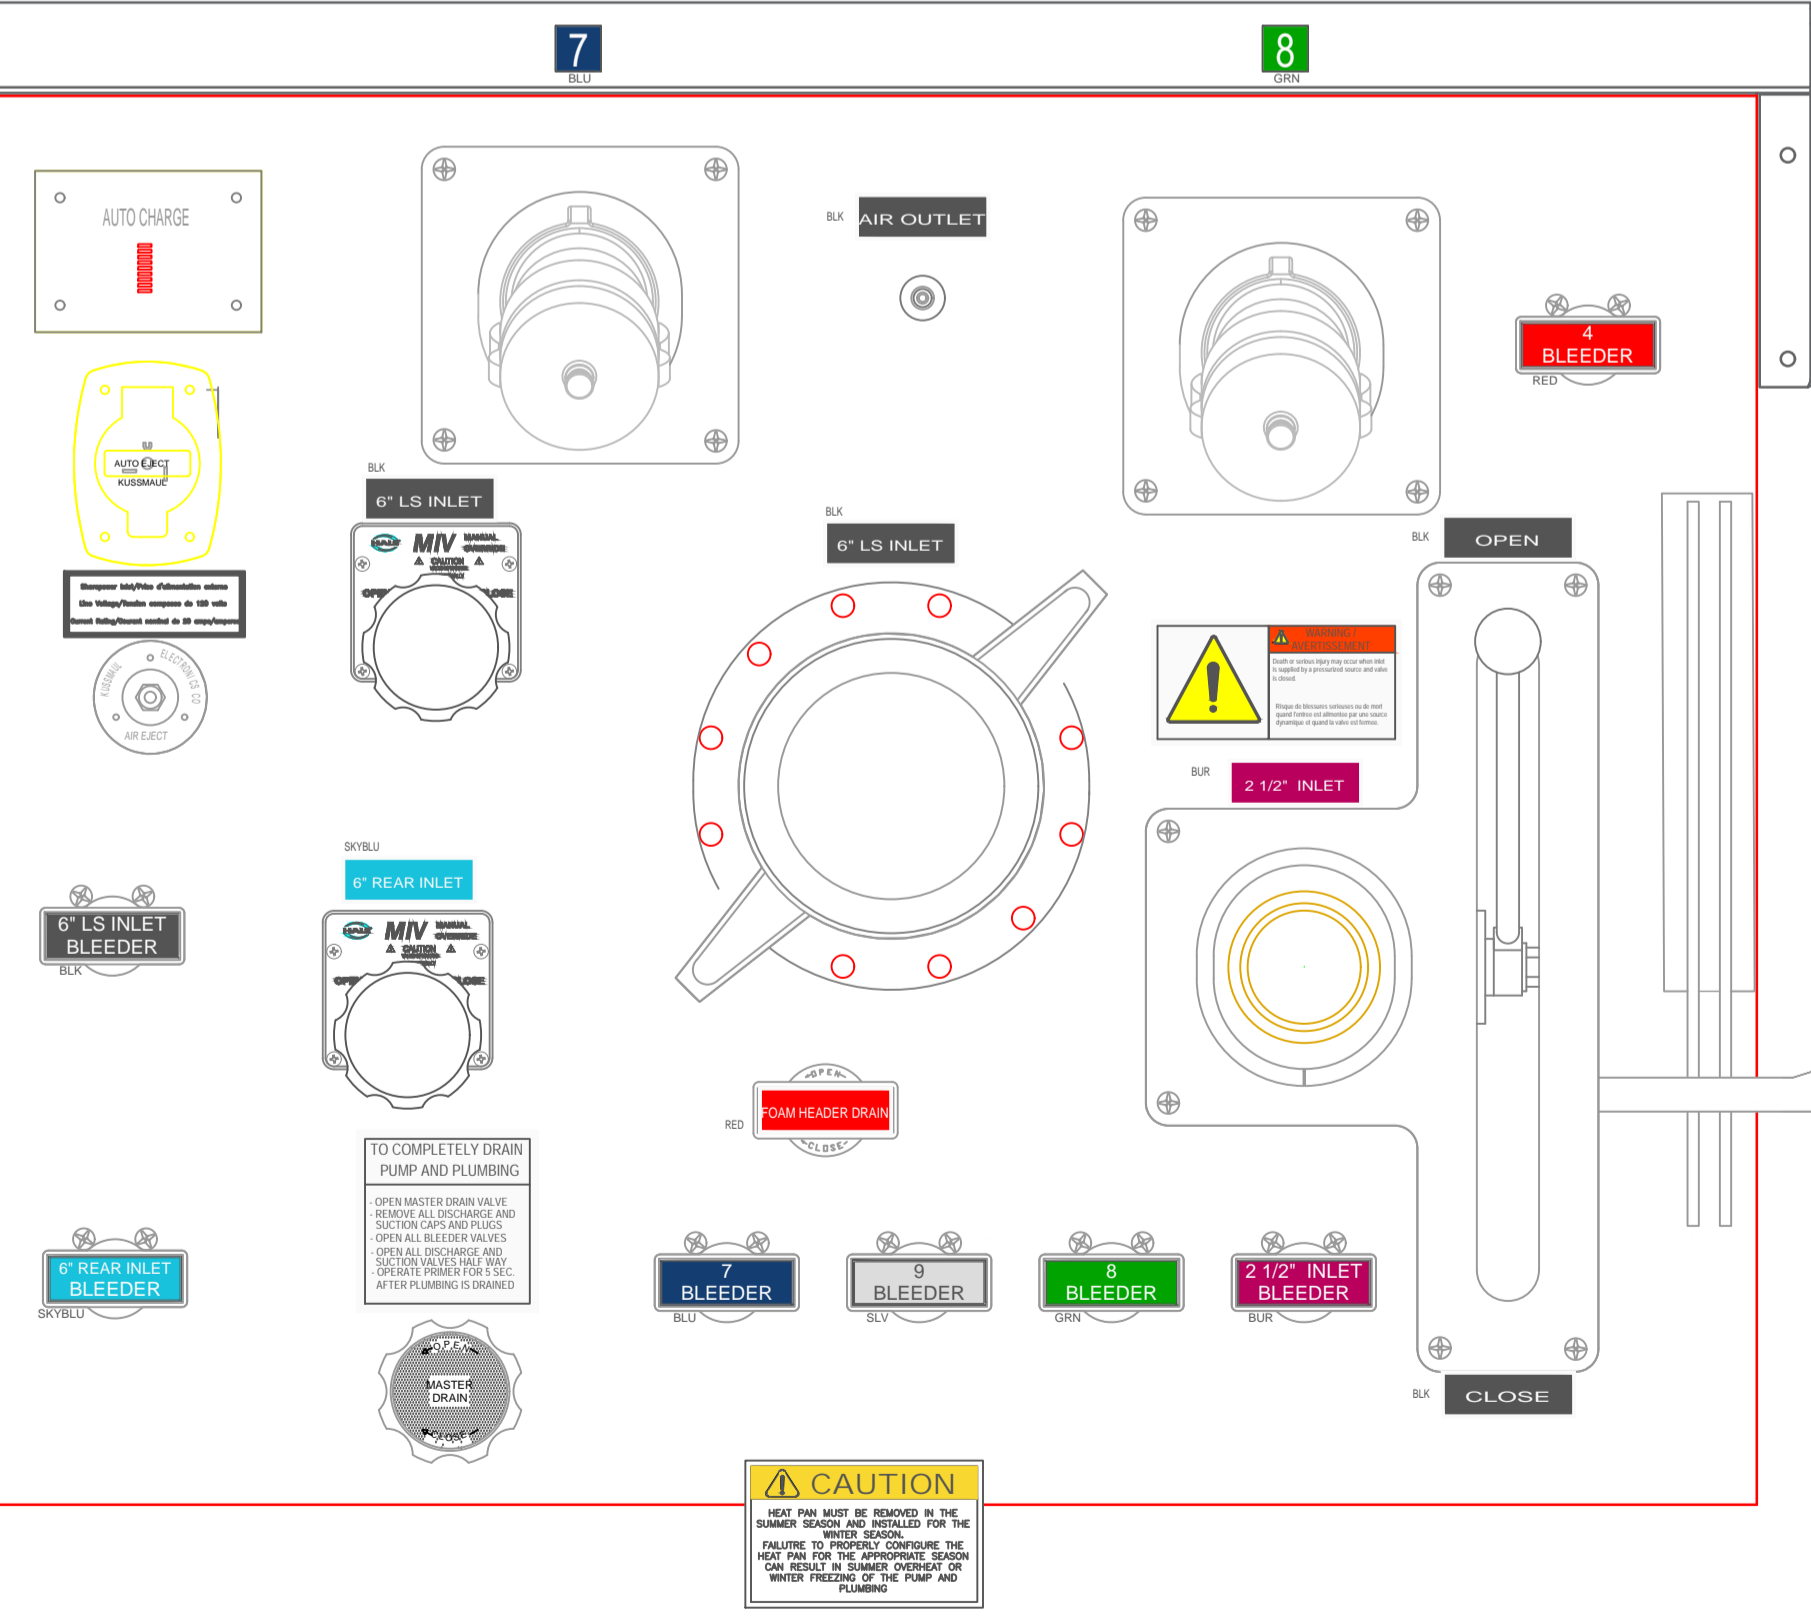
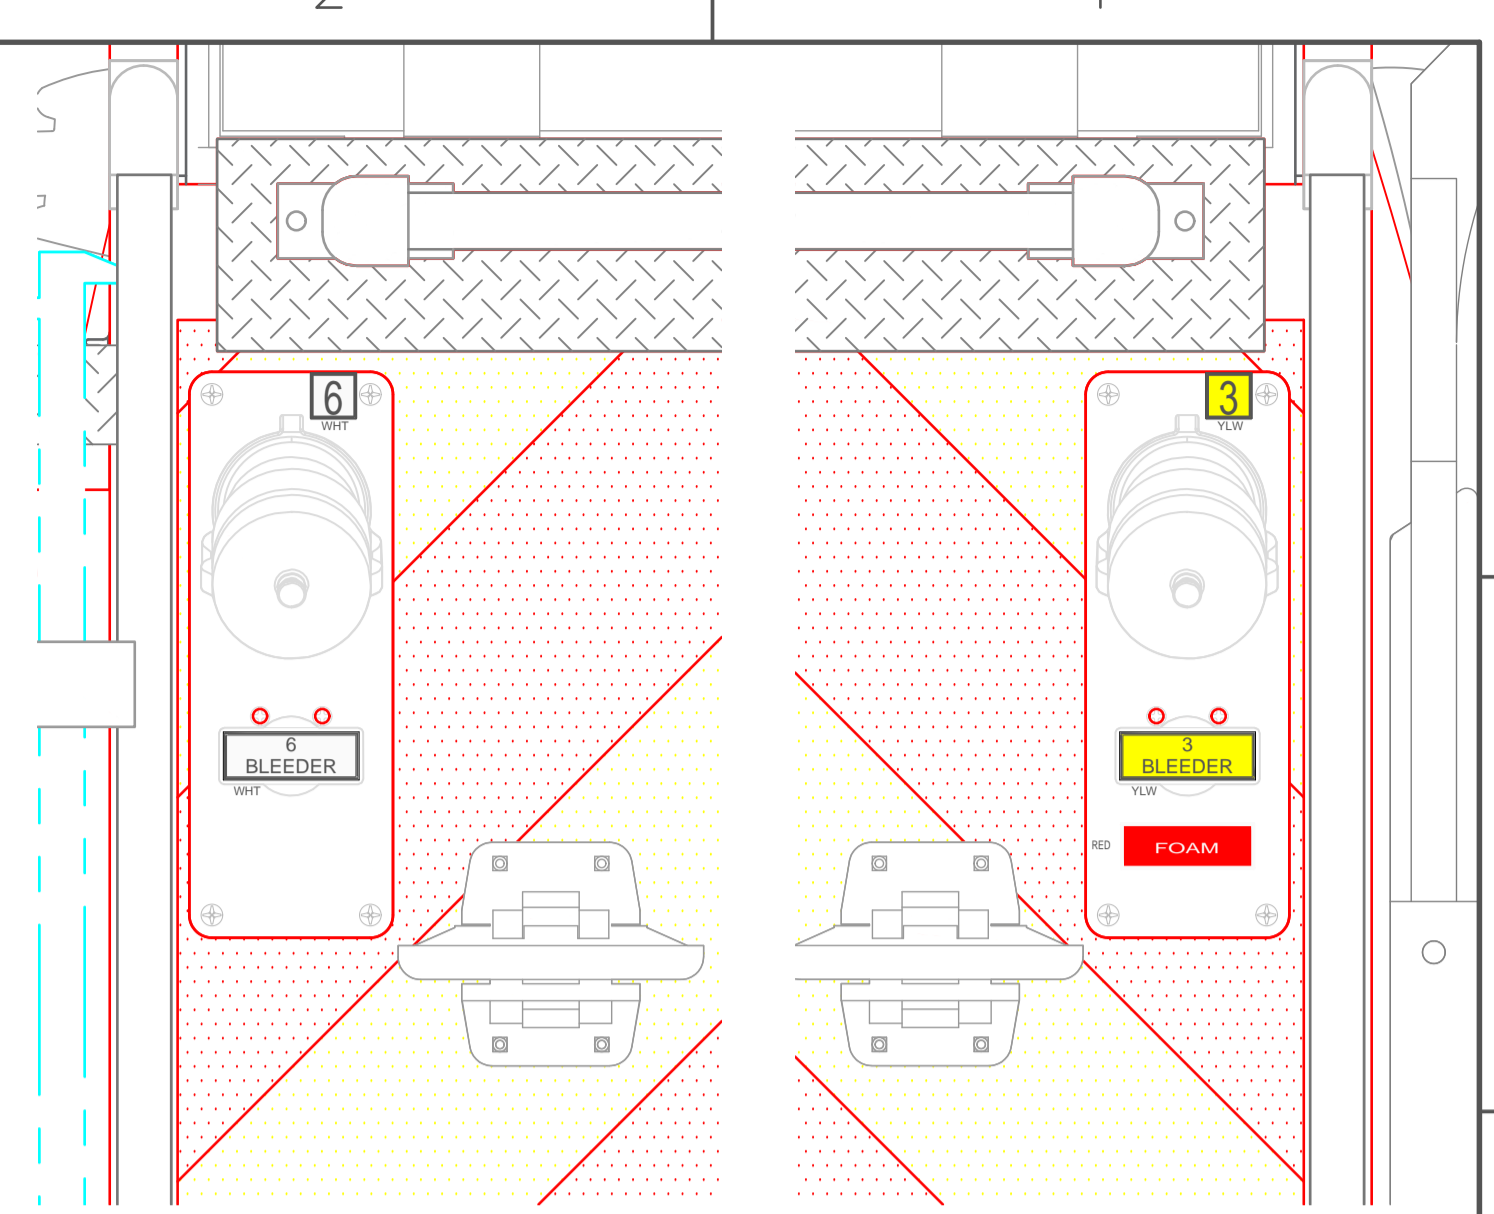


LOCATIONS FOR BARREL, FLOATING, & LOW LEVEL STRAINERS, & 2GAL WATER EXTINGUISHER TBD

1	ADDED LOCATIONS FOR ADJUSTABLE SHELVES, AS SHOWN	HDS	DEC 10, 2024
0	FIRST ISSUE		
REV	DESCRIPTION	BY	DATE
REVISIONS			
NORTH YORK FIRE DEPARTMENT		TITLE TOP VIEW & TAGS	
JOB No.	22513		
DRAWN BY	HDS		
DATE	JULY 2, 2024		
METALFAB LTD. 847 CENTRAL ST. CENTREVILLE NB. CANADA E7K 2E8		DRAWING NO.	22513-19 PG 2 OF 4
		REV	1

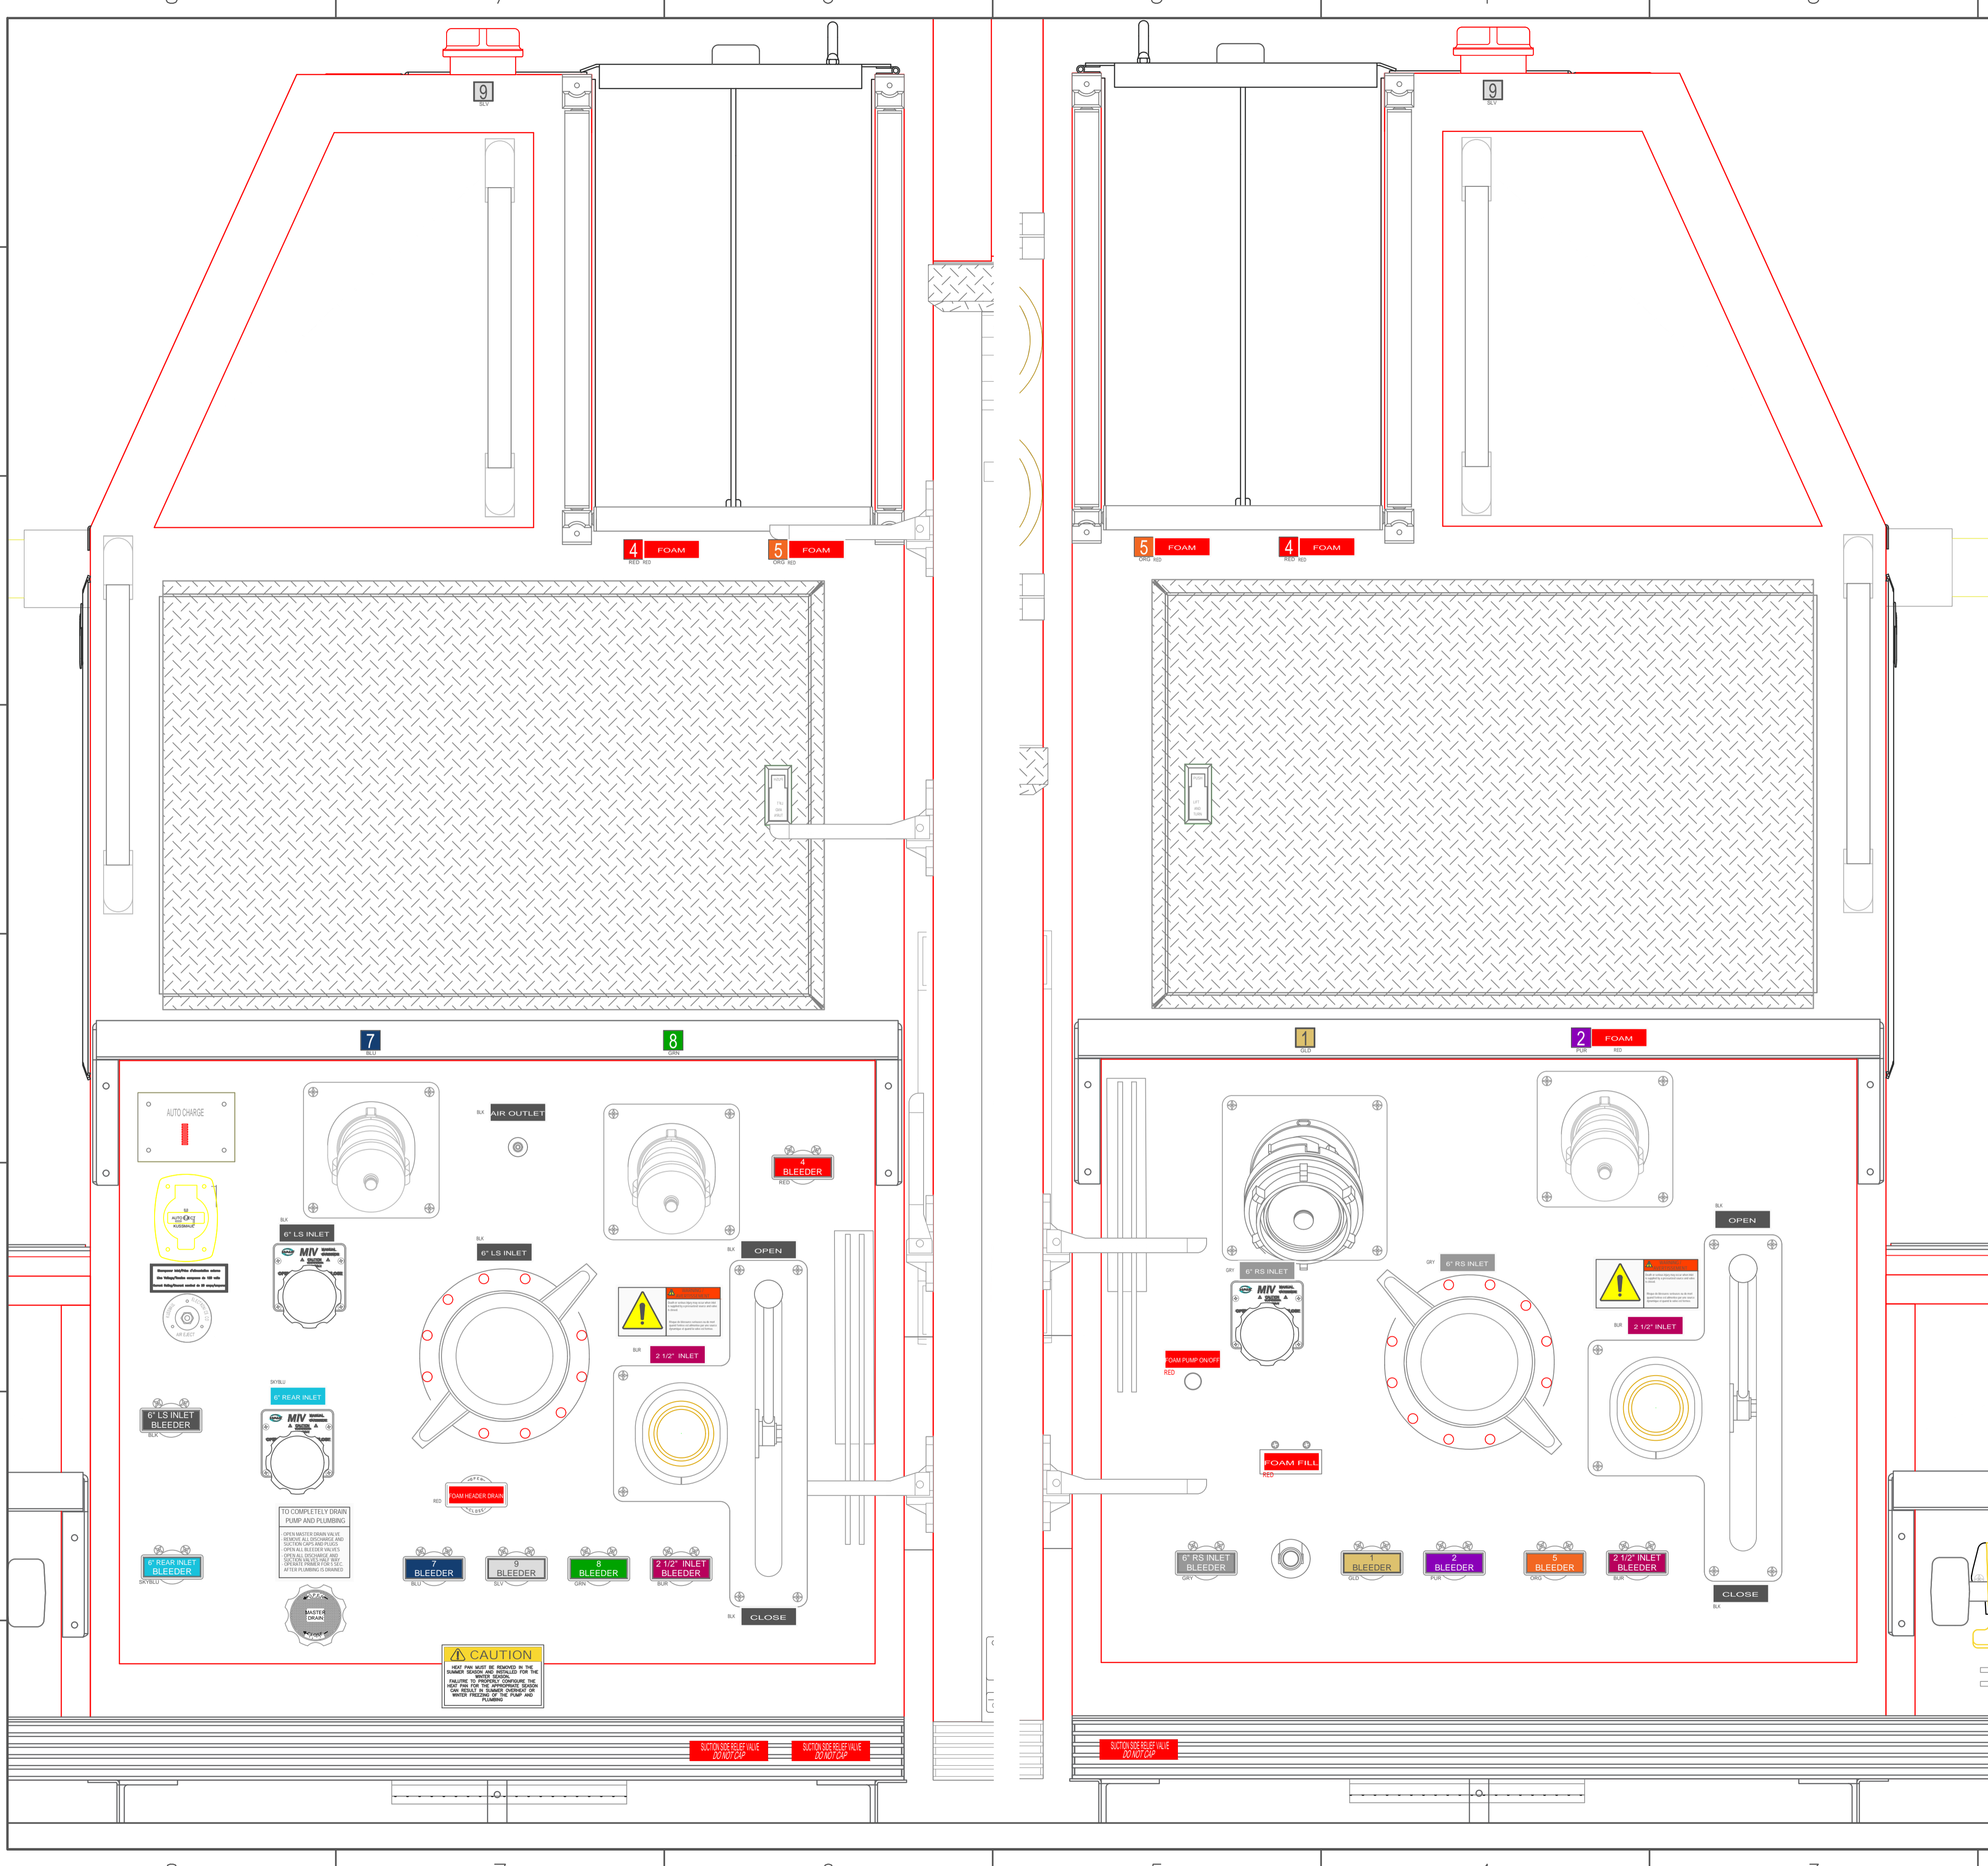

REV	DESCRIPTION	BY	DATE
1	ADDED LOCATIONS FOR ADJUSTABLE SHELVES, AS SHOWN	HDS	DEC 10, 2024
0	FIRST ISSUE		

NORTH YORK FIRE DEPARTMENT		TITLE PUMP PANEL LAYOUT	
JOB No.	22513		
DRAWN BY	HDS		
DATE	JULY 2 2024		
METALFAB LTD. 847 CENTRAL ST. CENTREVILLE NB. CANADA E7K 2E8		DRAWING NO. 22513-19	REV 1



CAUTION
 THIS PANEL MUST BE KEPT IN THE
 CLOSED POSITION AT ALL TIMES.
 FAILURE TO PROPERLY CLOSE THE
 PANEL MAY CAUSE DAMAGE TO THE
 WATER PUMP AND OTHER COMPONENTS.

SECTION SEE VALVE
DO NOT ZIP

SECTION SEE VALVE
DO NOT ZIP

8 7 6 5 4 3 2 1

H G F E D C B A

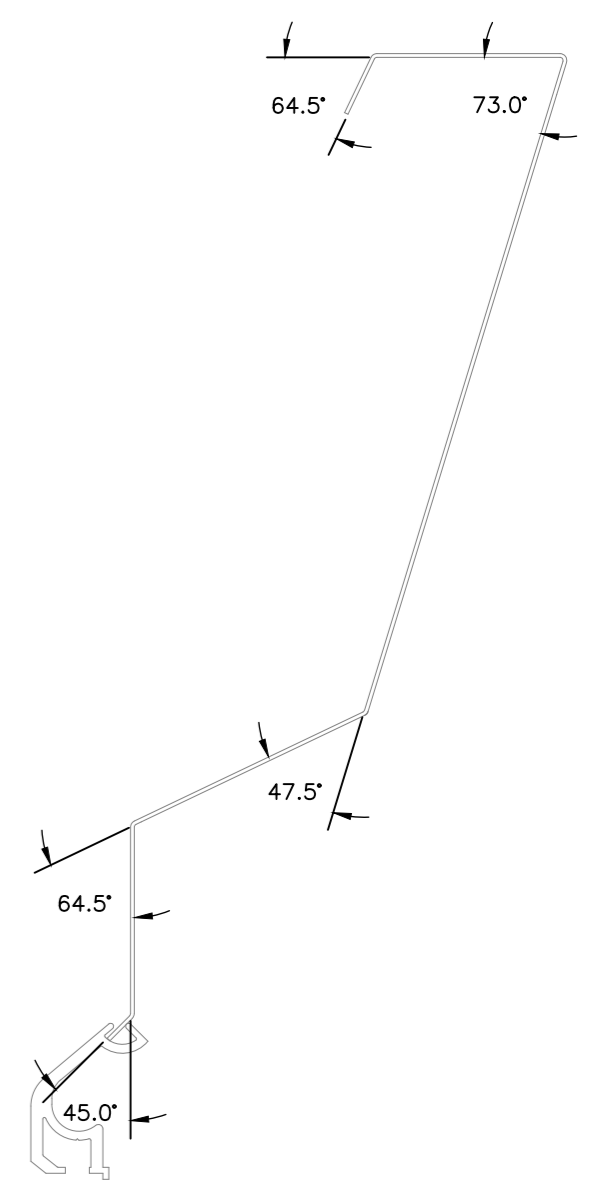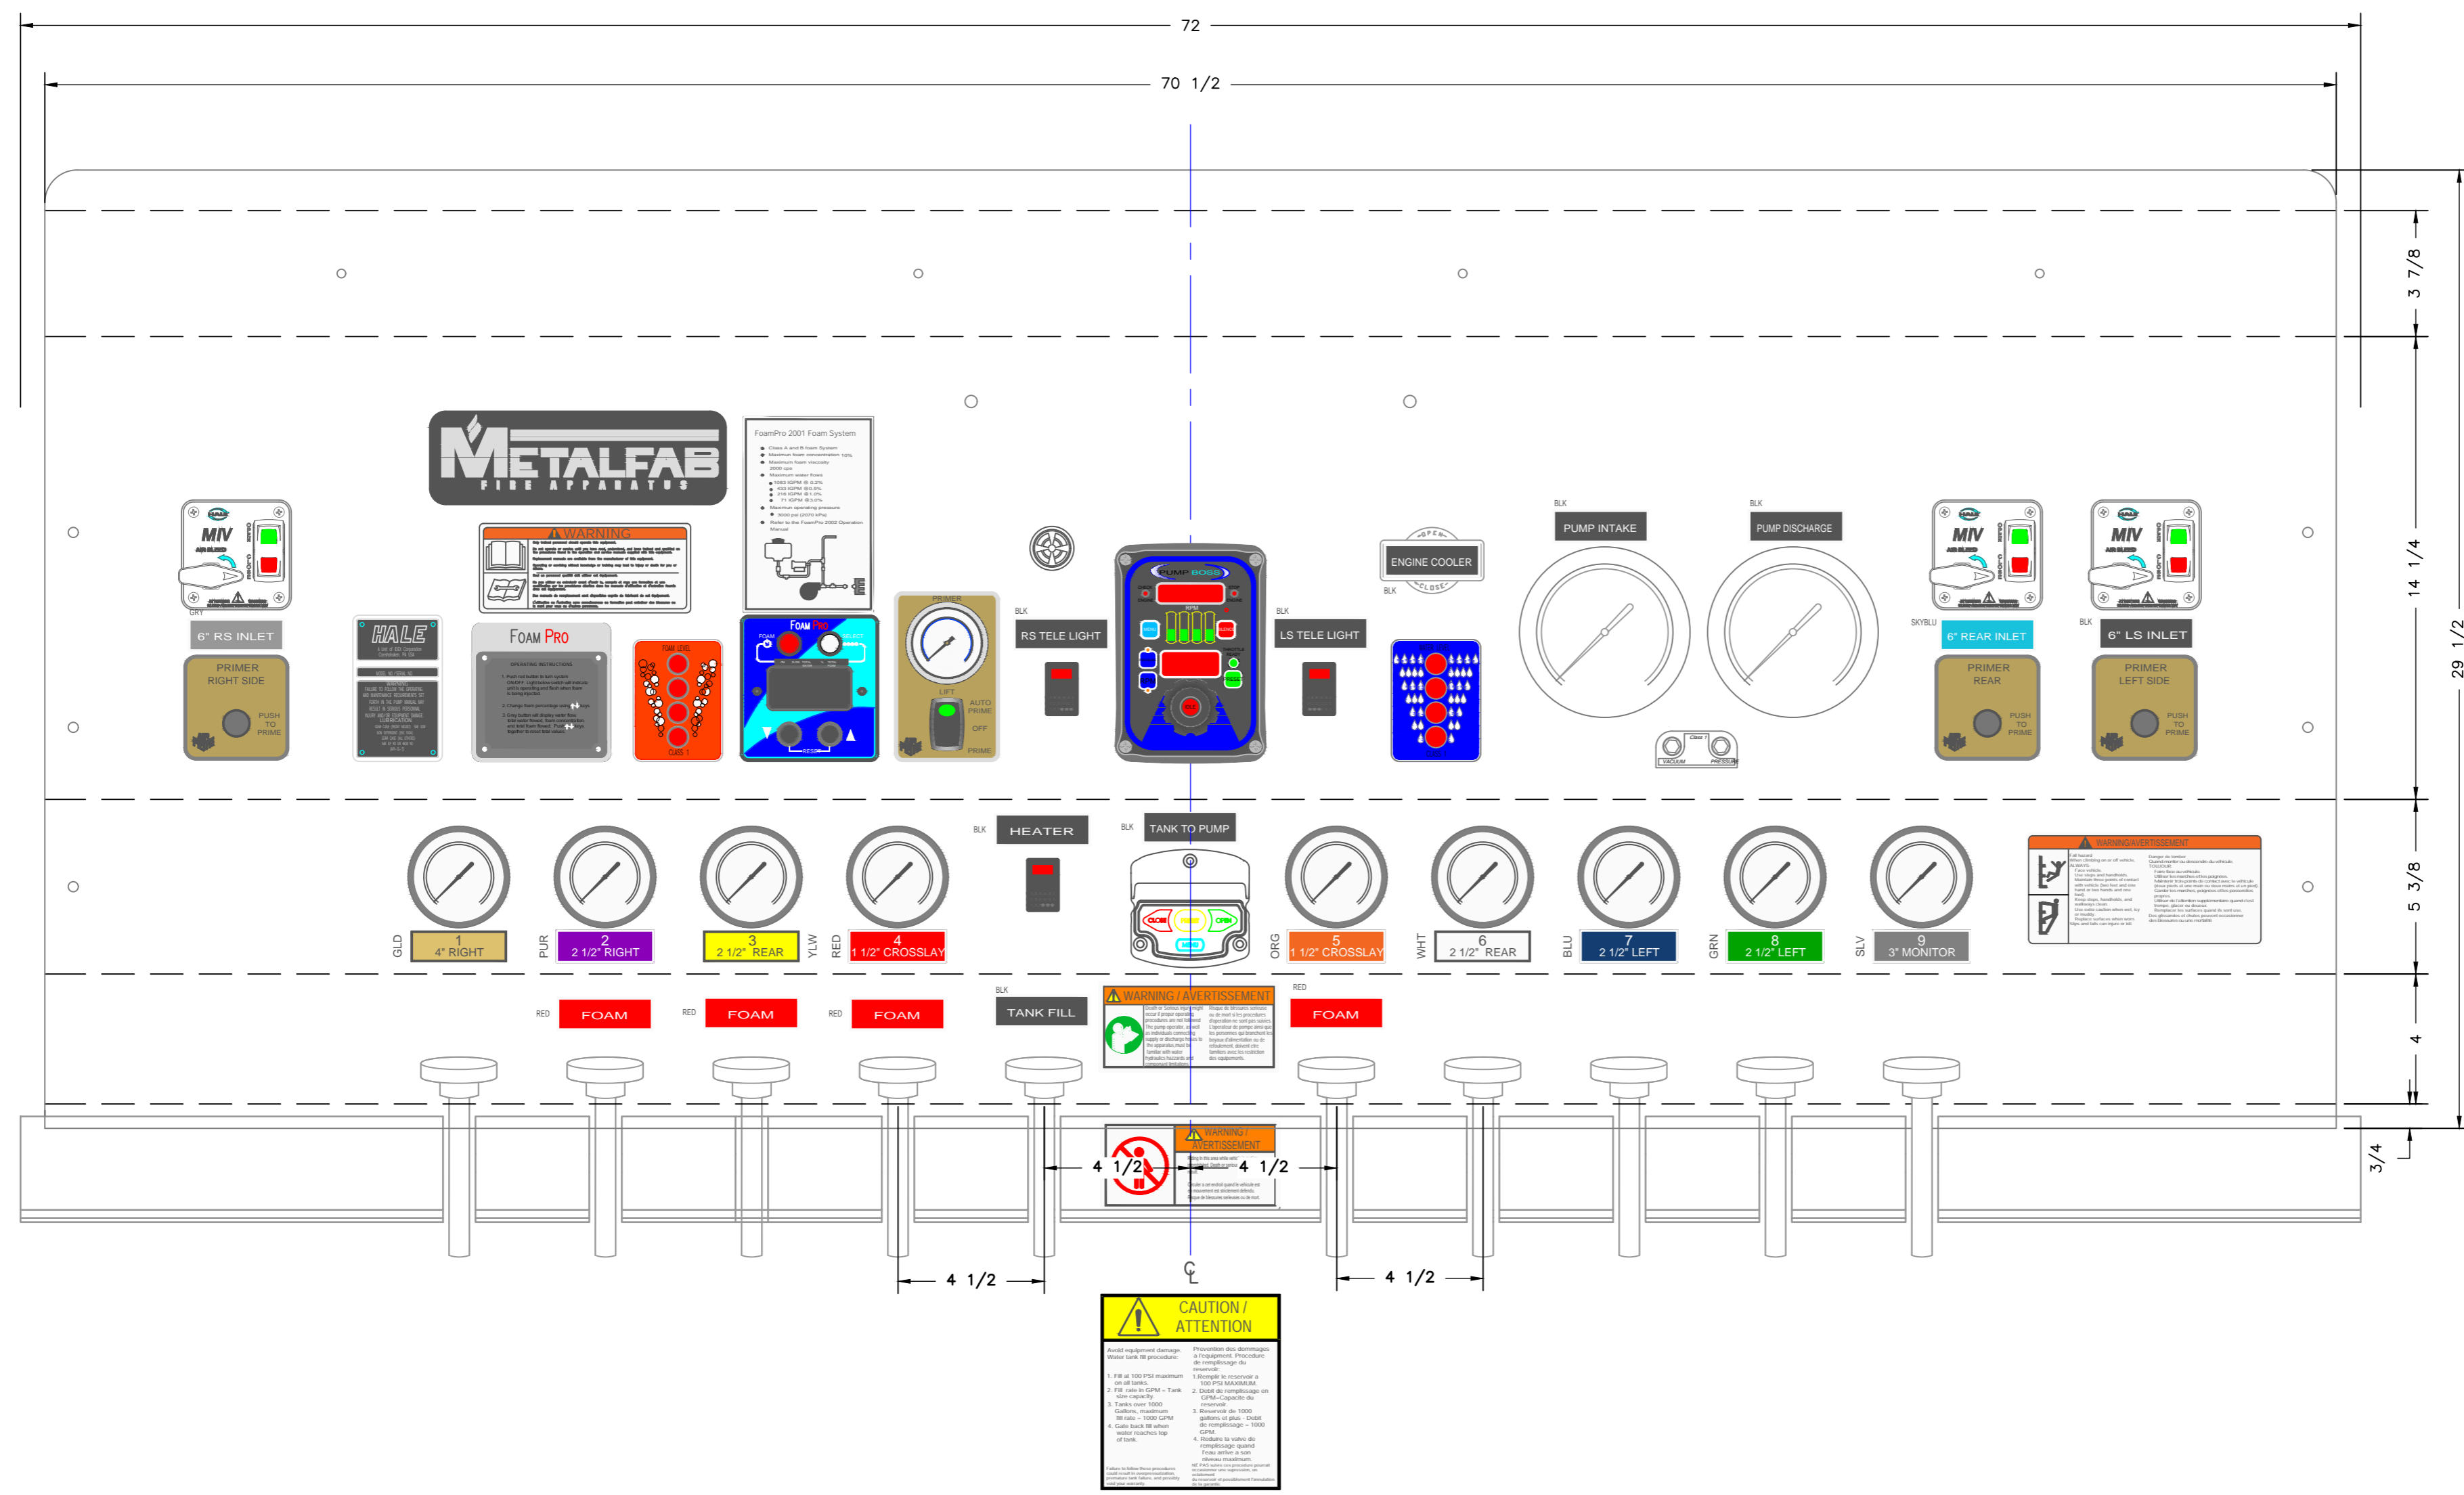

REV	DESCRIPTION	BY	DATE
1	ADDED LOCATIONS FOR ADJUSTABLE SHELVES, AS SHOWN	HDS	DEC 10, 2024
0	FIRST ISSUE		



REVISIONS	
TITLE	INSTRUMENT PANEL LAYOUT
TITLE	NORTH YORK FIRE DEPARTMENT
JOB No.	22513
DRAWN BY	HDS
DATE	JULY 2 2024
METALFAB LTD. 847 CENTRAL ST. CENTREVILLE NB. CANADA E7K 2E8	
DRAWING NO.	22513-19
REV	1

8 7 6 5 4 3 2 1


8 7 6 5 4 3 2 1

H
G
F
E
D
C
B
A

H
G
F
E
D
C
B
A

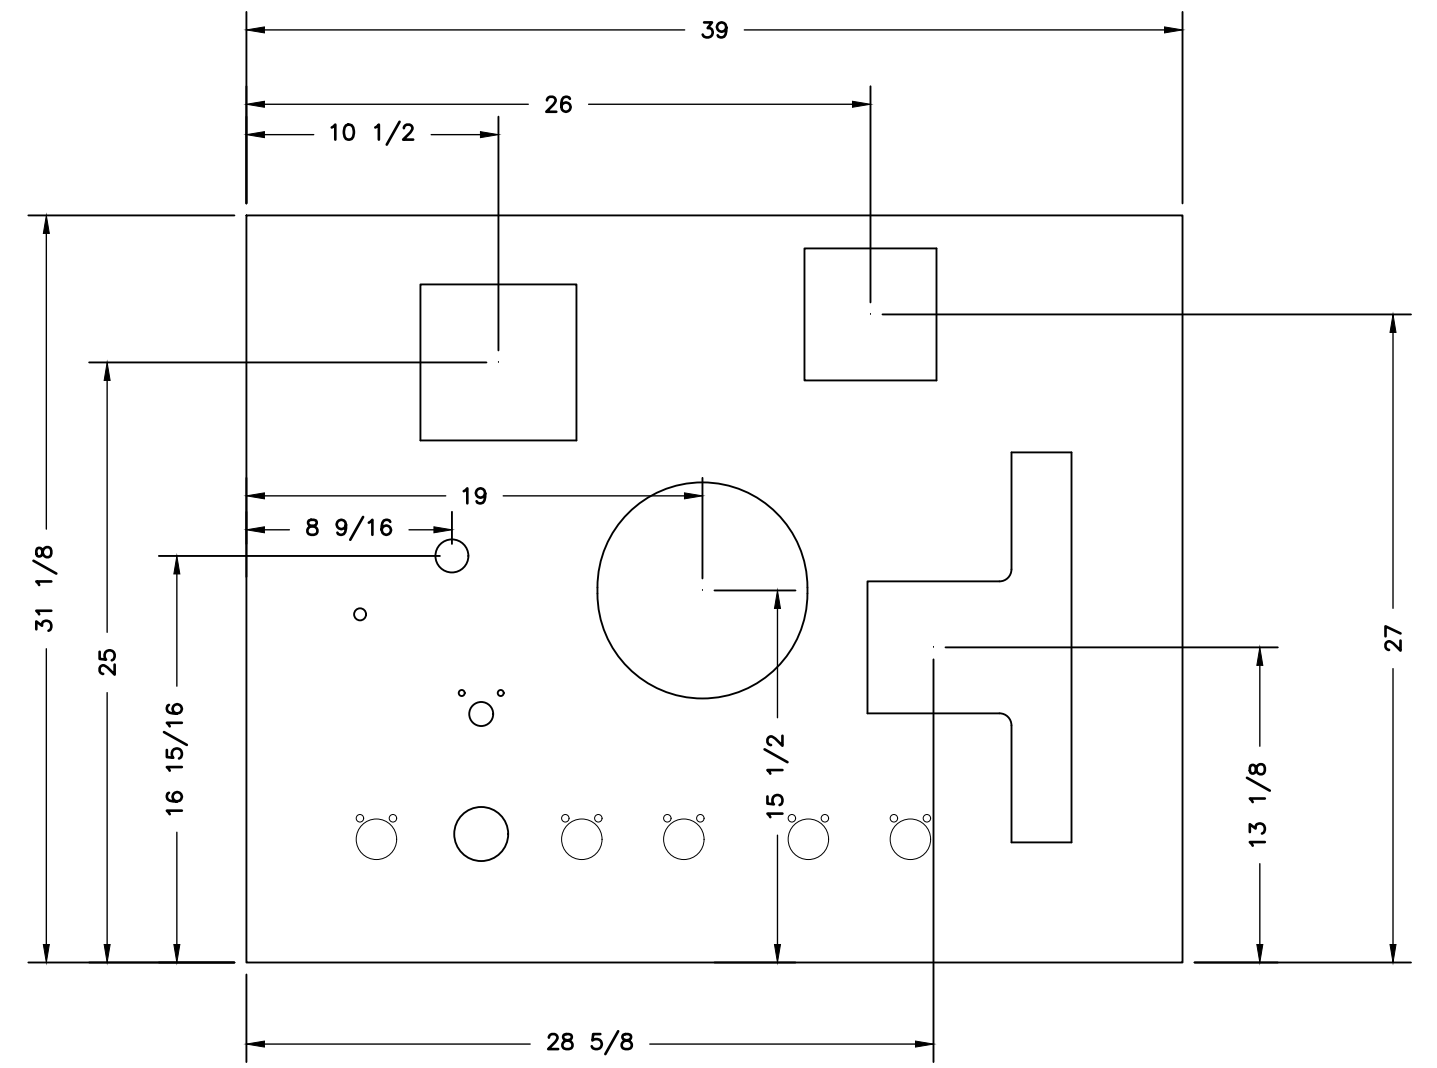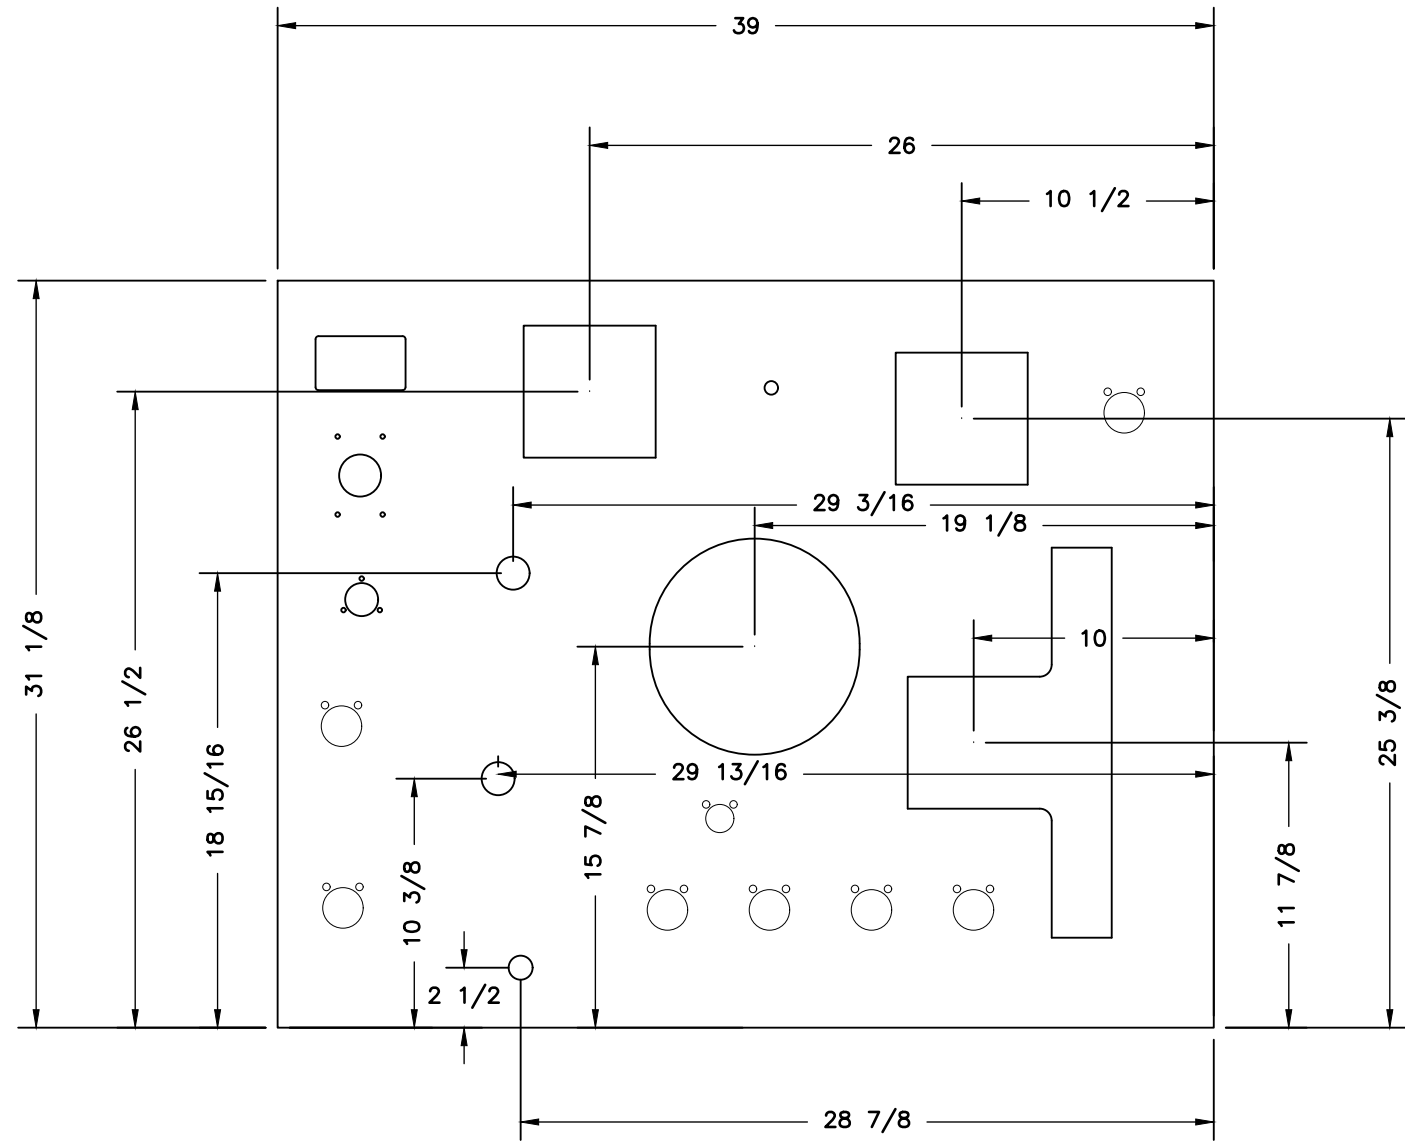

ALL PANELS ARE 14 Ga. STAINLESS STEEL
 REMOVE ALL SHARP EDGES/BURRS
 POLISH IN SANDER AFTER FITTED
 DXF - O:\CAD\NORTH YORK\SSPNLS.DXF

NORTH YORK FIRE DEPARTMENT		TITLE STAINLESS PANELS	
JOB No.	22513	 METALFAB LTD. 847 CENTRAL ST. CENTREVILLE NB. CANADA E7K 2E8	
DRAWN BY	T CULLINS		
DATE	SEPT 24 2024		
MANUFACTURING TOLERANCES		DRAWING NO.	22513-19
UNLESS OTHERWISE NOTED: ALL MACHINE OPERATIONS HAVE A TOLERANCE OF (+/-) 1/16"		REV	0

8 7 6 5 4 3 2 1